Optimal Power Flow Analysis of IEEE-30 bus System using Genetic Algorithm Techniques

Hari Om[1], Shuchi Shukla[2]

[1]M.Tech. (Scholar), Department of Electrical Engineering, RCERT, Jaipur, Rajasthan, India
[2]Associate Professor, Department of Electrical Engineering, RCERT, Jaipur, Rajasthan, India

Abstract— *This paper is focused at providing a solution to optimal power flow problem in power systems by using Genetic Algorithm approach. The proposed approach finds the optimal setting of OPF control variables which include generator active output, generator bus voltages, transformer tap-setting and shunt devices with the objective function of minimizing the fuel cost. The proposed Genetic Algorithm technique is modelled to be flexible for implementation to any power systems with the given system line, bus data, generator fuel cost parameter and forecasted load demand. Proposed genetic algorithm technique has been analyzed and tested on the standard benchmark IEEE 30-bus system. Results obtained after applying both optimization techniques on American Electric IEEE 30-bus system with the same control variable maximum & minimum limits and system data have been compared and analyzed. Proposed method efficiently optimizes and solves the optimal power flow problem with high efficiency and wide flexibility for implementation and analysis on different power system networks.*

Keywords— Optimal power flow, Fuel cost minimization, Genetic algorithm.

I. INTRODUCTION

The OPF Problem has been discussed since its introduction by Carpentier in 1962. As the OPF is a very large, non-linear mathematical programming problem, it has taken decades to develop efficient algorithm for its solution. Many different mathematical techniques have been employed for its solution. OPF has been applied to regulate generator active power outputs and voltages, shunt capacitors/reactors, transformer tap settings and other controllable variables to minimize the fuel cost, network active power loss, while keeping the load bus voltages, generators reactive power outputs, network power flows and all other state variables in the power system in their operational and secure limit .By considering the maximum / minimum outputs of generator, maximum MVA flows on transmission lines and transformers and bus voltages at their specified values, the primary goal of OPF is to minimize the generation cost for a particular given load demand. The secondary goal or another importance of OPF problem is the determination of marginal cost data. The marginal cost data deals with pricing MW transactions cost of auxiliary equipment that are required for reactive power (MVAr) for voltage support. The third goal of OPF is to monitor system security issues and also carry out necessary corrective actions. For planning studies, Optimal Power Flow is used to determine the maximum stress that a planned transmission system can withstand. To provide a preventive dispatch, the OPF can be set up if the security constraints are incorporated. In case of emergency, when some component of the system is overloaded or a bus is experiencing a voltage violation, the Optimal Power Flow can provide a corrective dispatch, which tells the system's operators what kind of adjustments can be performed in order to mitigate the overload or voltage violation problems. The calculation of the optimum generation pattern in order to achieve the minimum cost of the generation together while transmission system limitations are not violated. The OPF can be calculated by checking optimum settings for generation voltages, transformers taps and switch-able capacitors or static VAr components (called "Voltage- VAR" optimization) periodically [1].

II. PROBLEM FORMULATION

There are three types of buses in Power System:

i. Load Bus (PQ Bus)
ii. Generator Bus (PV Bus)
iii. Slack Bus (Swing Bus)

There are four variables named as

i. Real Power (P)
ii. Reactive Power (Q)
iii. Voltage Magnitude (V)
iv. Voltage Angle (δ)

Out of these four variables, two variables are known at each bus. In Load Bus, Real Power and Reactive Power are known i.e. active and reactive powers are injected into the network and Voltage Magnitude and Voltage Angle are unknown. Voltage Magnitude and Voltage Angle are to be calculated in this. In Generator Bus, Real Power and Voltage Magnitude are specified. The Reactive Power and Voltage Angle are to be determined. Voltage magnitude is kept constant at a specified value by injection of reactive power. These buses are also known as Regulated Buses/ Voltage Controlled Buses. In Slack Bus, Voltage Magnitude and Voltage Angle are known and Real Power and Reactive Power are to be determined. This Bus makes up the difference between the scheduled load and generator power that are caused by losses in the network. This Bus is taken as Reference Bus. If slack bus is not specified then the generation bus with usually with a maximum active power P is taken as reference bus.[1]

TABLE: 1

TYPE OF BUS AND ITS VARIABLES

TYPE OF BUS	KNOWN VARIABLE	UNKOWN VARIABLE
Load Bus (P-Q Bus)	P,Q	V, δ
Generator Bus (PV bus)	P,V	Q, δ
Slack Bus (V- δ Bus)	V, δ	P,Q

III. METHODOLOGIES

The main aim of electric supply utility is provide the Smooth electrical energy to the consumers taking into account that the electrical power is generated with minimum cost. It is only possible when the total demand is shared to all the units. This will lead to cost minimization. The objective function is represented by quadratic curves of second order. The major considerations for the fulfilling the objective of this is minimize the fuel cost the general definition of optimization problem is given by:

Minimize: f(x, u) . . . . . (i)

Subject to: g(u, x) = 0 . . . . . (ii)

$h(u, x) \geq 0$

Where,

f: Objective Function . . . . . (iii)

g: Equality Constraints .... (iv)

h:Inequality Constraints .... (v)

u and x represents a set of controllable and dependent variables respectively.

3.1 Objective Function

No more than 3 levels of headings should be used. All headings must be in 10pt font. Every word in a heading must be capitalized except for short minor words as listed in Section III-B.

The main objective function helps to minimize the operating cost. The objective function is the function of the real power generation. The objective function for the OPF reflects the costs associated with generating power in the system. The quadratic cost model for generation of power will be utilized. The Objective Function is the function of real power generation

$$F = \mathrm{ai} + \mathrm{bi}\,(\mathrm{Pgi}) + \mathrm{ci}\,(\mathrm{Pgi})^2$$

Where:

Pgi is the amount of generations in MW at generator i
ai , bi , ci are the cost coefficients

This objective function will minimize the total system costs, and does not necessarily minimize the costs for a particular area within the power system. It is scalar function of the variable of the problem. So the objective function for the whole power system for cost minimization is

$$F = \sum_{i=1}^{NG} (\text{ai} + \text{bi}\,(\text{Pgi}) + \text{ci}\,(\text{Pgi})^2)$$

Where
ai, bi, ci are the cost coefficients
NG is the number of generation including the slack bus

3.2 The Controls

In Optimal Power Flow Problem, the objective function can be minimized directly by adjusting the values of the control variables and satisfy the constraints. The control variables can be given as:

i. Active Power Generation
ii. Reactive Power Generation
iii. Transformer Tap Ratio
iv. Generator Bus Voltage

The Control variables help in making the desired results. For example, the active power generation cost is minimized by controlling the active power generation. The main function of the control variables is to minimize the cost of generation by adjusting them to appropriate values.

3.3 The Dependent Variables

These are those variables which are not under control. These include all type of variables that are free to assume value to solve the particular problem. The main dependent variables are the complex bus voltage angle and magnitude.

3.4 Inequality Constraints

In Optimal Power Flow Problem, the equality constraints reflect the physics of the power system. The objective function can be minimized only when the power system is running under normal condition while the network components are operating within limits i.e. The net power generation should be equals to the sum of total demand and total losses.

This can be achieved by the active and reactive power analysis:

Pi = Pload + PLoss
Qi = Qload + QLoss

Where:

Pi & Qi are the active and reactive power outputs Pload & Qload are the active and reactive load power Ploss & Qloss are the active and reactive power loss.

IV. GENETIC ALGORITHM SOLUTION

4.1 GENETIC ALGORITHM

A genetic algorithm (GA) [2, 3, 4, 5] is an optimization technique using artificial intelligence. The method is based on Darwin's survival of the fittest hypothesis. In a GA, candidate solutions to a problem are analogous to individual animals in a population. Although the initial population can be a random collection of bizarre individuals, the individuals will interact and breed to form future generations. Stronger individuals will reproduce more often than will weaker individuals.

In a genetic optimization problem, the objective is to maximize a fitness function. The fitness is calculated for each member of the population, and some individuals are selected to survive into the next generation. Under roulette-wheel selection an individual's probability of survival is directly proportional to its fitness value. The selection operation forms the next generation of solutions by copying randomly chosen survivors from the previous generation. It is possible that some very fit functions might be copied into the next generation more than once (cloning), while some unfit functions might not be copied at all (death). Because of the probabilistic nature of this selection mechanism, it is also possible for the best solution to be passed over and not be chosen for survival. This work uses elitism to guarantee that the best solution will always survive. Once the new generation of solutions is formed, the genetic crossover operators form new solutions by combining old solutions according to a predetermined set of rules. Furthermore, genetic mutation operators randomly alter some of the new solutions, in order to add diversity to the population. The choice of crossover operator depends on the problem being

optimized and the structure of the solutions. Because of the manner in which genetic methods use the fitness function, great flexibility is afforded the designer. Unlike other optimization methods, the genetic methods do not impose constraints on the form of the fitness function. Since a GA does not differentiate the fitness function, the fitness function does not need to be differentiable or even continuous. Furthermore; this flexibility allows the direct enforcement of constraints. The GA can be constructed so that it never generates an illegal set of control variables. However, it is still possible that one or more of the dependent (output) variables violates a constraint. If this happens, the designer is afforded the choice of discarding the solution, keeping the solution but penalizing its fitness value, or repairing the solution in a manner which will make it better fit the constraints. Each of these methods has its individual advantages and limitations, which require analytical and intuitive skills by the designer to select and apply intelligently. The best choice depends on the problem being solved. Discarding illegal solutions guarantees that illegal solutions will not be accepted, but it causes the population to lose diversity. Keeping an illegal solution while penalizing its fitness will allow its survival, thereby keeping its diversity in the population but will not guarantee that the final solution is legal. Repair algorithms require special skill to design and usually slow the execution rate of the algorithm.

4.2 FLOW CHART OF GA

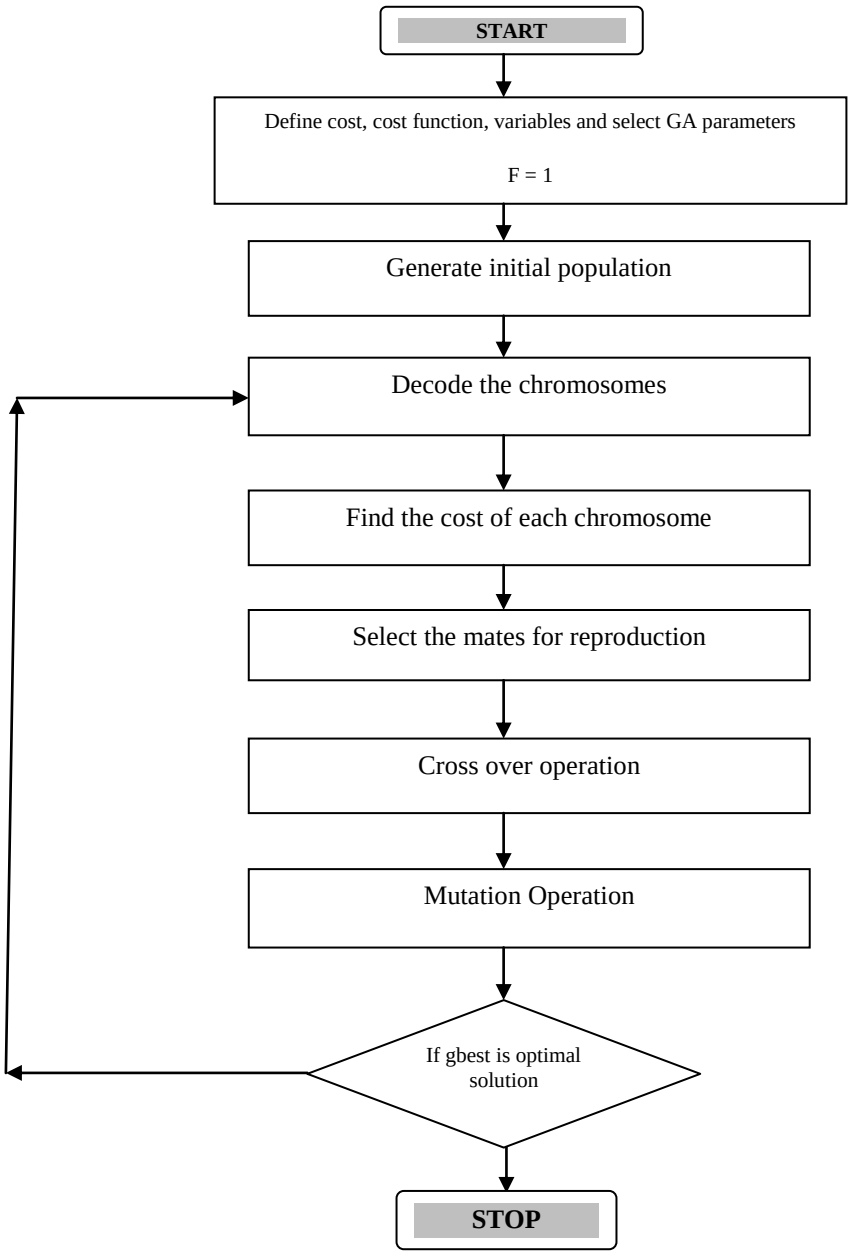

V. RESULTS

Results of OPF by Genetic Algorithm- The value of converged genetic algorithm is expressed as follows

1. **The value of objective function (Output Cost Function) =** 802.296
2. **P_{gg}(Output of Control Variable)** = 177.9992 , 51.8479, 20.3332, 17.6587, 12.3484, 12.8551
3. **TL(Transmission Loss) =** 9.6426

VI. CONCLUSION

This paper mainly studied the PSO method and GA method. It is used to provide the solution involving numerical analysis. The PSO method and GA method needs less number of iterations to reach convergence, and is more accurate and not sensitive to the factors. In addition, this project also studied optimal power flow based the IEEE 30 bus system. Optimal power flow is the condition that the cost of overall power system is the lowest. This project concerns a general cost minimization problem to solve the power flow problem based on IEEE 30 bus system.

ACKNOWLEDGEMENTS

My sincere thanks are due to **Mr. Anshu Surana** (Vice Chairman), **Mr. Anil Boyal** (Associate Professor) Regional College For Education Research & Technology, Jaipur for his valuable support in completion of the dissertation work.

Words are inadequate in offering in thanks to the **Prof. (Dr.) R.S. Tiwari** (Director R&D), **Prof. (Dr.) Himani Goyal** (Principal) Regional College for Education Research & Technology, Jaipur for their encouragement and cooperation in carrying out the project work.

REFERENCES

[1] Hari om, Shuchi Shukla "Optimal Power Flow Analysis of IEEE-30 bus System using Soft Computing Techniques" National Paper on Advanced soft computing techniques, 2015.

[2] Neural-Net Based Real-Time Economic Dispatch For Thermal Power Plants Miodrag Djukanovic Milan Calovic Borka Milogevik Dejan J. Sobajic IEEE Transactions On Energy Conversion, Vol. 11, No. 4, December 1996.

[3] Chen, Ying-ping, and Pei Jiang. "Analysis of particle interaction in particle swarm optimization." Theoretical Computer Science 411.21 (2010): 2101-2115.

[4] Cai, Jiejin, et al. "A fuzzy adaptive chaotic ant swarm optimization for economic dispatch." International Journal of Electrical Power & Energy Systems 34.1 (2012): 154-160.

[5] Kumar, Rajesh, et al. "A novel multi-objective directed bee colony optimization algorithm for multi-objective emission constrained economic power dispatch."International Journal of Electrical Power & Energy Systems 43.1 (2012): 1241-1250.

[6] A. Bakirtzs, V. Petridis, S. Kazarlis, "Genetic algorithm solution to the economic dispatch problem", IEEE Proceedings, Generation, Transmission and Distribution, vol. 141, no 4, 1994, pp. 377-382

[7] http://www.powermin.nic.in..

[8] M. Dorigo, V. Maniezzo, A.Colorni, "Ant System: Optimization by a Colony of Cooperating Agents", IEEE Trans Syatem, Man, Cybernetics Part B, vol. 26, no. 3, 1996 pp. 29-41.

[9] Laouer, Mohammed, et al. "New Approach of Optimal Power Flow with Genetic Algorithms." Acta Electrotechnica et Informatica Vol 8.2 (2008): 35-42.

[10] Das, Swagatam, Ajith Abraham, and Amit Konar. "Particle swarm optimization and differential evolution algorithms: technical analysis, applications and hybridization perspectives." Advances of Computational Intelligence in Industrial Systems. Springer Berlin Heidelberg, 2008. 1-38.